


Waterbased (AQ) High Gloss varnish
Gloss value >60-50 (according to ISO2813)

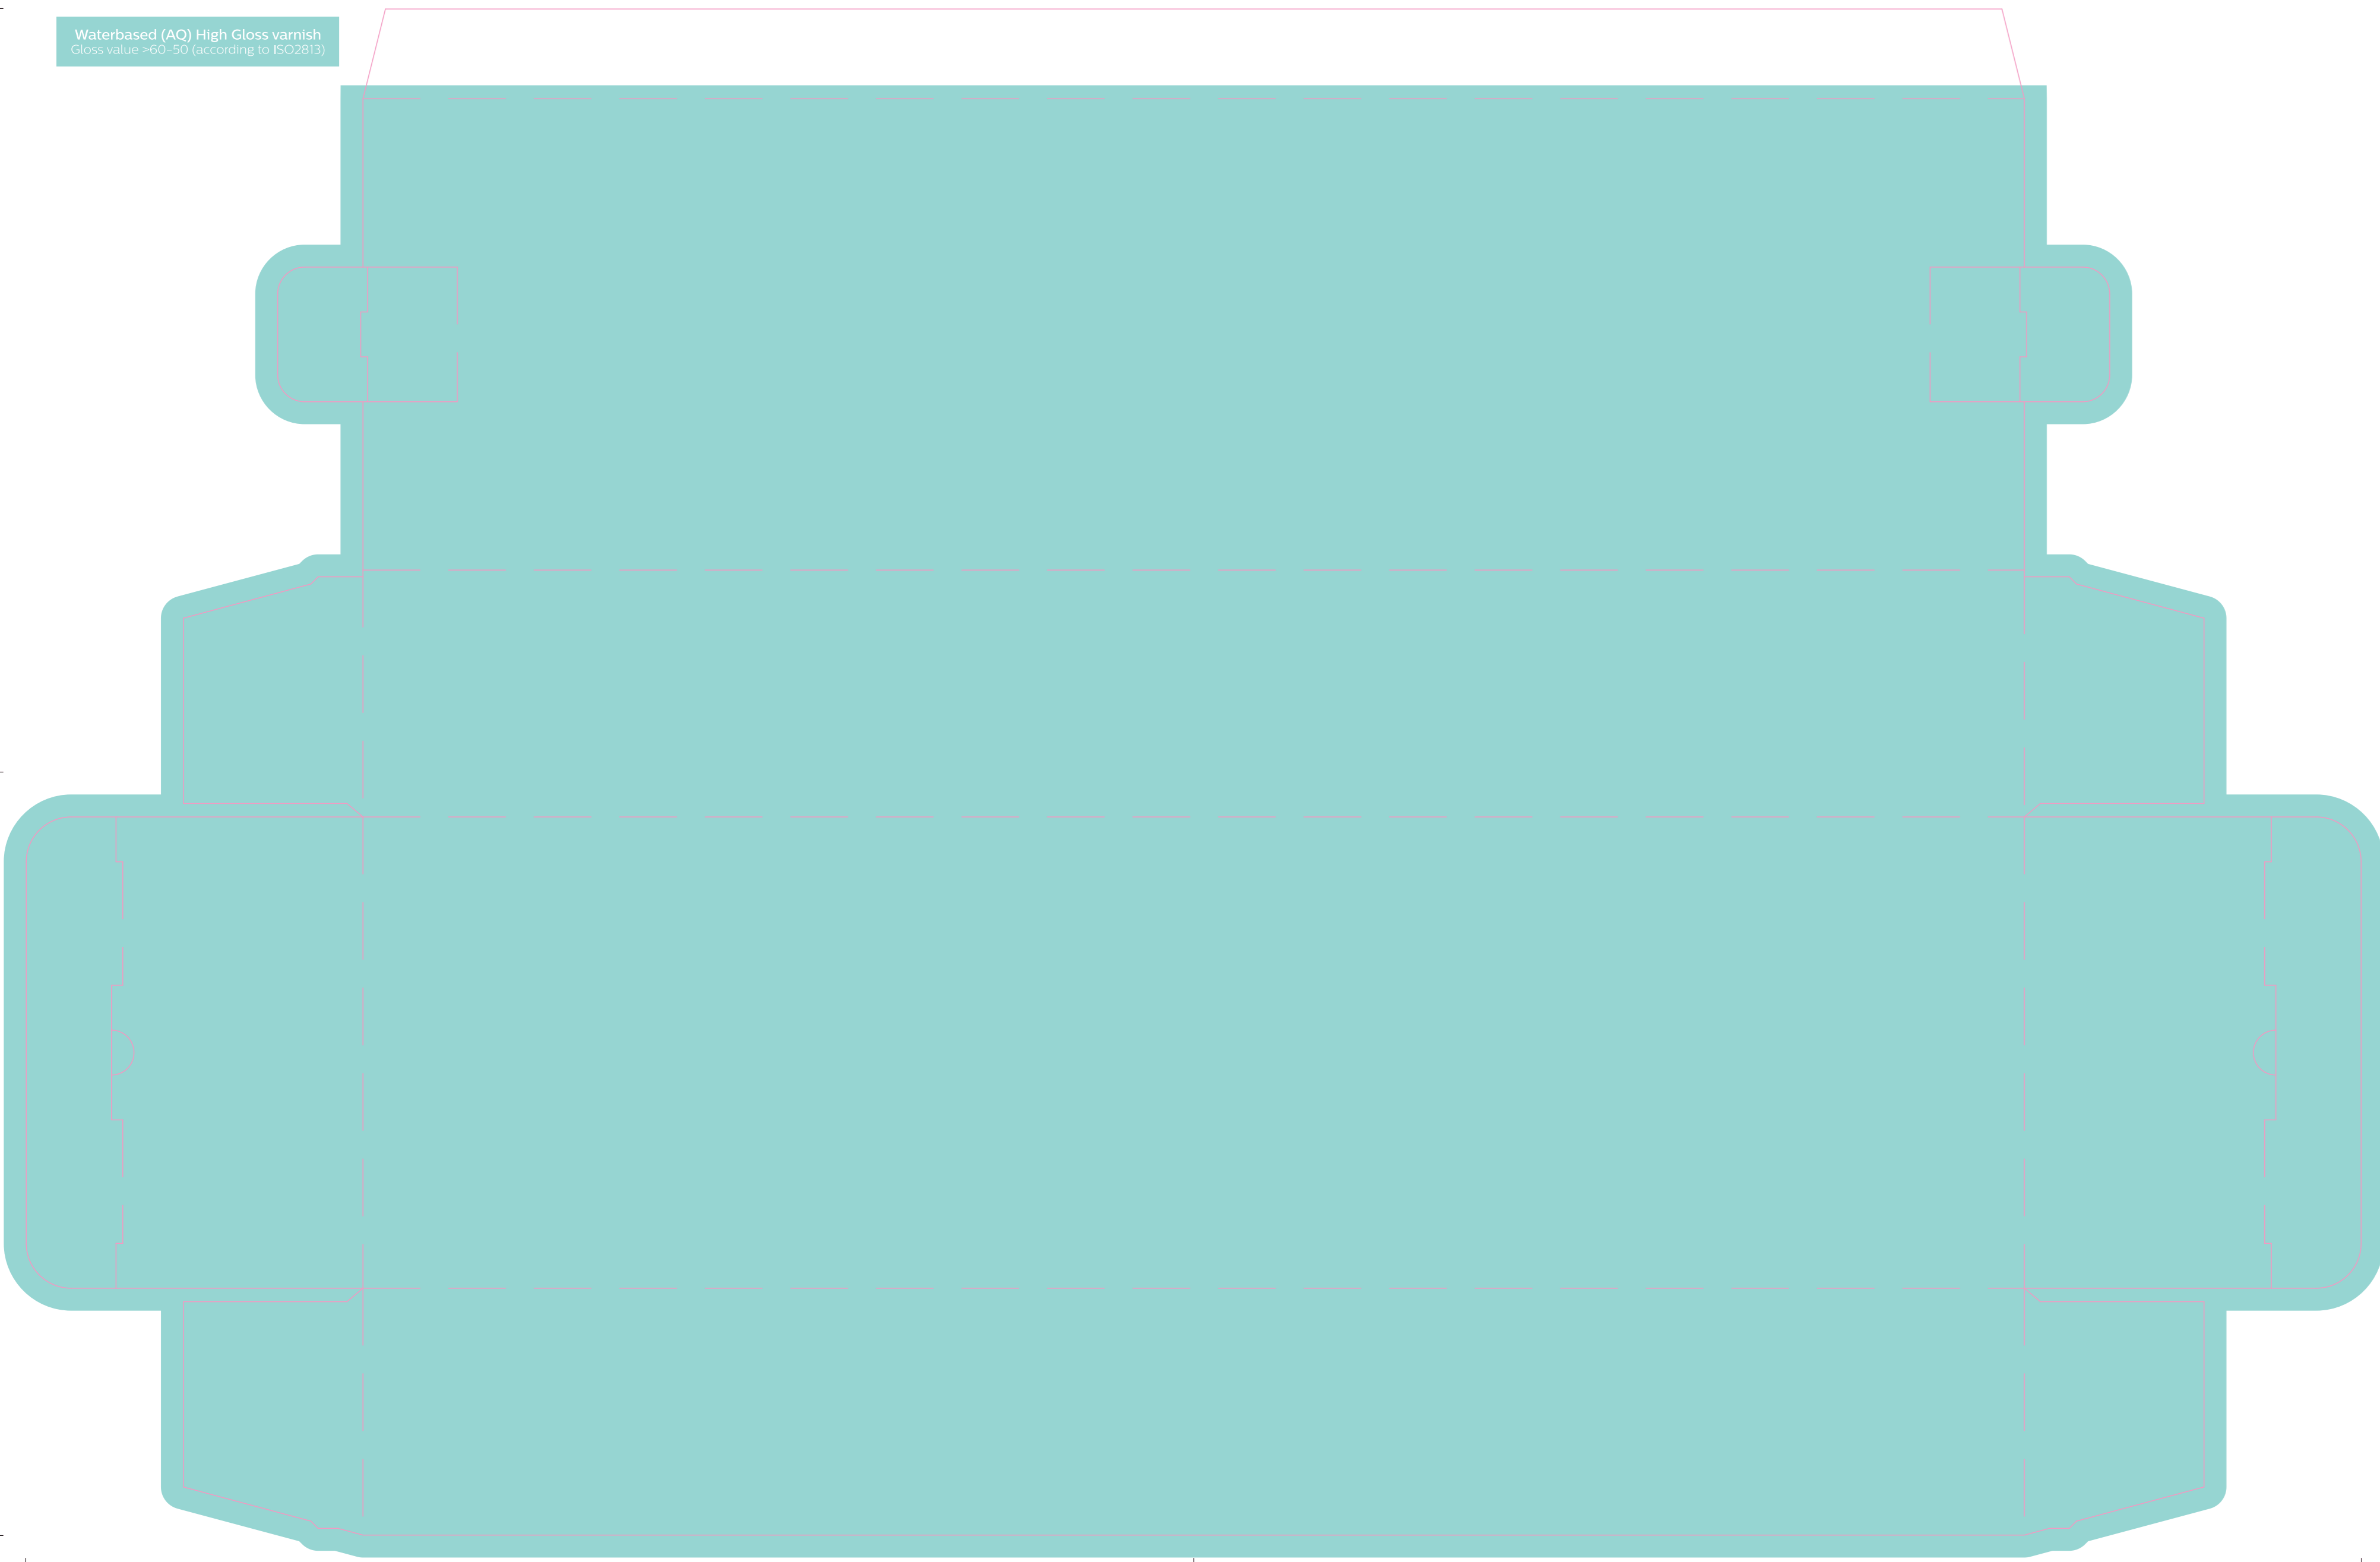

| PHILIPS HEALTHTECH | | | |
|--|---|---------------------------------|--------------------------------|
| Main Article Group | Hair Care (E04) | | |
| Project name | BHB862_00_EE_37003 | | |
| SGS number | 5112206 | | |
| 12-NC.NBR | 314003637003 | | |
| Masterdrawing | | | |
| Barcode No. | 8710103819479 | | |
| Size | BWR Type | | |
| Operator(s) | vasanth.mudiyappan | | |
| VERSION No. | 9 | | |
| Date in | 22/10/2019 | | |
| Date amended | 23-Oct-19 | | |
| <input type="checkbox"/> Cyan | <input type="checkbox"/> Magenta | <input type="checkbox"/> Yellow | <input type="checkbox"/> Black |
| <input type="checkbox"/> Water Based Gloss | <input type="checkbox"/> Diecut | <input type="checkbox"/> | <input type="checkbox"/> |
| <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Date Check | | | |
| <input type="checkbox"/> Check to Client Brief | | | |
| Artwork document | | | |
| <input type="checkbox"/> Legend | <input type="checkbox"/> Number of colors | | |
| <input type="checkbox"/> 12NC | <input type="checkbox"/> Trapping/Bleed | | |
| <input type="checkbox"/> Barcode | <input type="checkbox"/> Hi-res Images | | |
| <input type="checkbox"/> Diecut | <input type="checkbox"/> Job Size | | |
| Deliverables | | | |
| <input type="checkbox"/> PDF 1.3 | <input type="checkbox"/> Epson | | |
| <input type="checkbox"/> PDF 1.5 | <input type="checkbox"/> Leapfile | | |
| Approval | | | |
| <input type="checkbox"/> QC Lithographer | SGS | | |
| <input type="checkbox"/> Product Manager | | | |
| <input type="checkbox"/> Project Manager | Elise de Graaff | | |