


individuals with specific medical conditions.  
medical practitioner

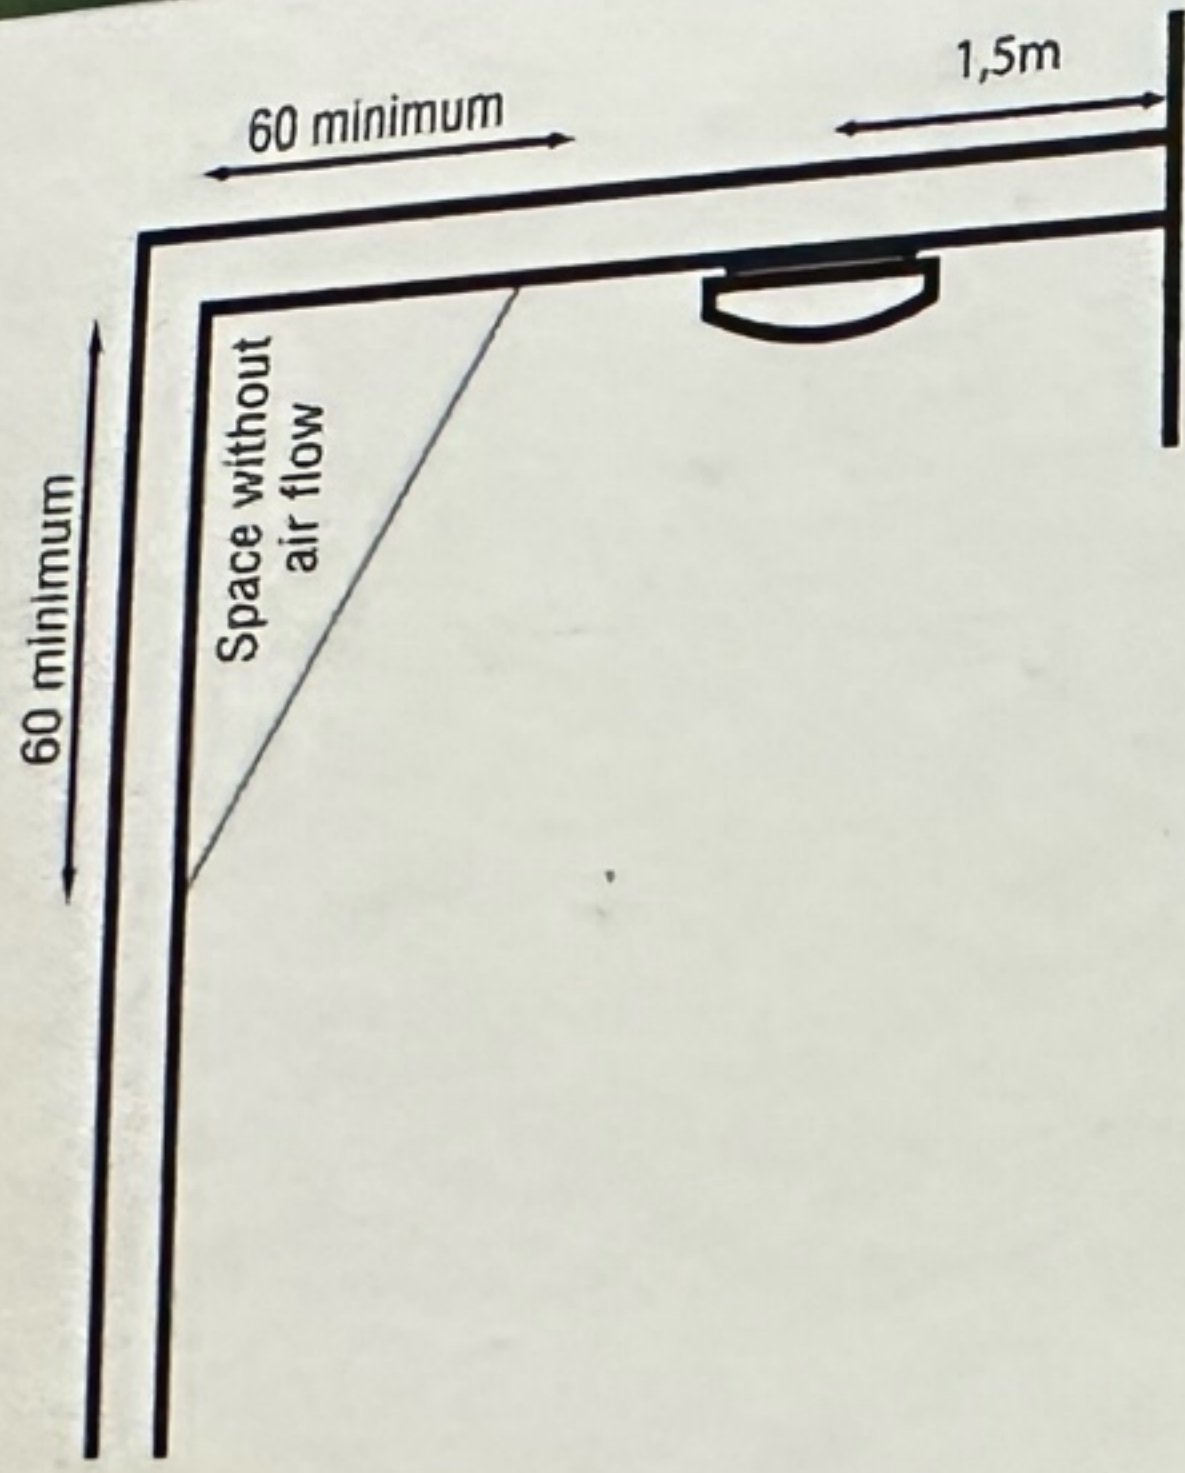


This device must be installed  
by a competent person

Storage temp: 4 to 50 degrees

Celsius, max humidity: 90 %

Sensitivity: < 15% LEL

Sensor expiry date: 01/2029

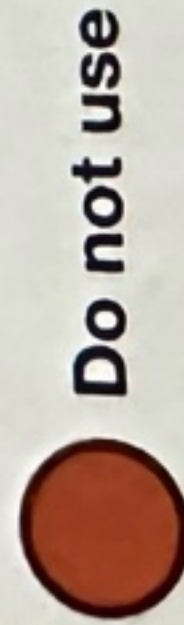

Do not use

Wall
mA DC
adapter included
backup battery

LM201A DE 12702637 V1.5

Hesdo b.v.  
Aziëlaan 12, 5232 BA  
's-Hertogenbosch  
The Netherlands

